

FEATURES

- Field-Bus remote data acquisition
- Modbus Slave device on RS-485
- Modbus RTU Protocol
- 1 Universal Analogue Input + 1 Analogue Input V/mA
- 2 Analogue Outputs 0-20mA
- 3 Digital Inputs
- 1 SSR Digital Output + 2 SPST Relay Outputs
- Watch-Dog Alarm
- Remotely Configurable
- 1500 Vac galvanic isolation on all the ways
- High Accuracy
- UL / CE mark
- DIN rail mounting in compliance with EN-50022



GENERAL DESCRIPTION

The DAT 3011 device is able to acquire RTD or Tc sensors, mV, V or mA input signals connected to the universal analogue input in engineering units in digital format. Moreover it is available a second isolated analogue input for V or mA. The device is able to acquire up to 3 digital inputs and to drive one solid-state relay and two SPST relays. The Data are transmitted with MODBUS RTU protocol on the RS-485 network.

The device guarantees high accuracy and a stable measure versus time and temperature. To ensure the plant safety two Watch-Dog timer alarms are provided. The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The DAT 3011 is in compliance with the Directive 2004/108/EC on the electromagnetic compatibility.

The DAT 3011 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 22.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device).

Connect power supply, serial bus, analogue and digital inputs and outputs as shown in the "Wiring" section.

When the device is powered, the green LED "PWR" is fixed in ON condition, the yellow LED "STS" changes state and depends on the working condition of the device: refer to the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.


To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)


INPUT			Input Impedance			POWER SUPPLY	
Input type	Min	Max	mV, TC	10 MΩ	Power supply voltage	18 .. 30 Vdc	
			Volt	1 MΩ	Reverse polarity protection	60 Vdc max	
Voltage			mA	22 Ω	Current consumption	100 mA max.	
100 mV	-100 mV	100 mV	Thermal Drift (1)		ISOLATION		
10 Volt	-10 V	10 V	Inputs - Full Scale	± 0.01 % / °C			
TC			Thermal Drift CJC		(Power supply - RS485 – Universal input – V mA Input – Digital Inputs – Analogue Outputs)		
	J	-210°C	1200°C	Full Scale			± 0.02 °C/ °C
	K	-210°C	1370°C	Sample time	1 sec.		
	R	-50°C	1760°C	Warm-up time	3 minutes		
	S	-50°C	1760°C	OUTPUT (2 channels)			
	B	400°C	1825°C				
	E	-210°C	1000°C	Output type	Min	Max	
	T	-210°C	400°C	Current	0 mA	20 mA	
	N	-210°C	1300°C	Accuracy (2)			± 0.05 % f.s.
RTD 2,3 wires			Linearity (2)			± 0.05 % f.s.	
	Pt100	-200°C	850°C	Thermal Drift (2)			± 0.01 % / °C
	Pt1000	-200°C	200°C	Load resistance			< 500 Ohm
	Ni100	-60°C	180°C	Auxiliary Voltage			> 12V @ 20 mA
	Ni1000	-60°C	150°C	Data Transmission			
Resistance 2,3 wires			Baud Rate			38.4 Kbps	
	Low	0 Ω	500 Ω	Max. distance			1.2 Km – 4000 ft
High	0 Ω	2000 Ω	DIGITAL INPUTS				
Potentiometer			Number of Channels			3	
Current			Input voltage			OFF State : 0÷3 V	
	20 mA	-20 mA	20 mA	(bipolar)			ON State : 10÷30 V
Accuracy (1)			Input Impedance			4.7 KOhm	
	mV, Volt, mA	± 0.05 % f.s.	DIGITAL OUTPUTS				
	Pot, RTD, Res.	± 0.05 % f.s	N.1 SSR Output				
	TC	> ± 0.05 % f.s. or 5 uV	Voltage			30 Vac / 48 Vdc	
	Linearity (1)			Current (resistive load)			0.4 A max
		mV, Volt, mA	± 0.05 % f.s.	N.2 Relays SPST			
		Pot, RTD, Res.	± 0.1 % f.s	Maximum switching power per contact (resistive load)			
	TC	± 0.2 % f.s.	2 A @ 250 Vac				
	RTD, Res, Pot excitation current			2 A @ 30 Vdc			
		Typical	0.700 mA	5Vdc, 10mA			
Lead wire resistance influence			250Vac (50 / 60 Hz) ,				
	RTD/Res 3 wires(50 Ω max balanced)	0.05 f.s. %/Ω	110Vdc				
mV, Tc	< 0.8 uV/Ohm		Dielectric Strength between contacts				
NOTES:			1000 Vac, 50 Hz, 1 min.				
(1) Referred to input Span (difference between max. and min. values)			Dielectric Strength between coil and contacts				
(2) Referred to output Span (difference between max. and min. values)			4000 Vac, 50 Hz, 1 min.				

WIRING


ANALOG INPUT 0 - UNIVERSAL

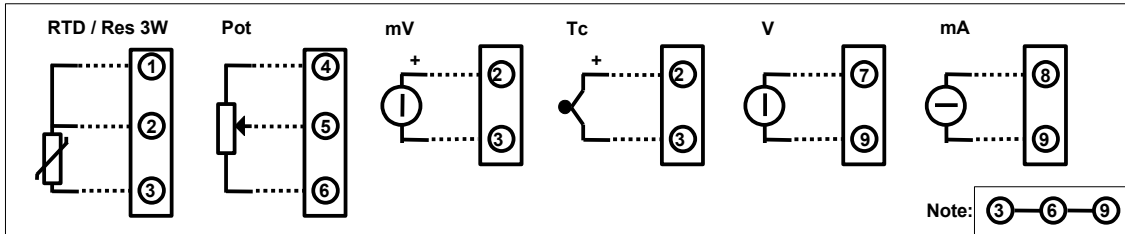


ANALOG INPUT 1 - V / mA

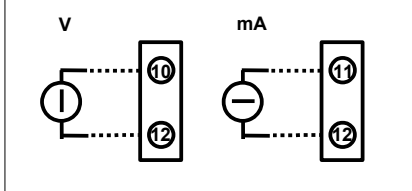


RS-485




POWER SUPPLY (*)



INIT




DIGITAL OUTPUTS

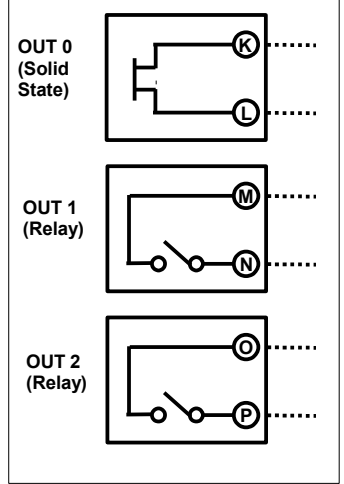


(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

ANALOG OUTPUTS - mA

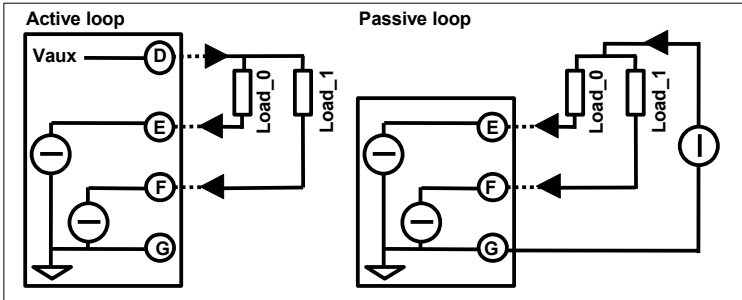

DIGITAL INPUTS

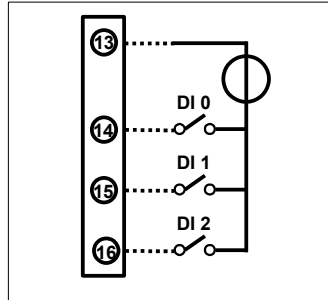

ISOLATIONS

1 UNIVERSAL ANALOG INPUT	RS485 LINE
1 V / mA INPUT	2 ANALOGUE OUTPUTS
3 DIGITAL INPUTS	SUPPLY
	1 SOLID STATE RELAY
	2 SPST RELAYS

INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and at least one of the overload conditions exist.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.

LIGHT SIGNALLING

LED	COLOR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
STS	YELLOW	ON	System Error
		OFF	Correct working
RX	RED	BLINK	Data receiving from RS-485
		OFF	No Data receiving
TX	RED	BLINK	Data Transmission on RS-485
		OFF	No Data Transmission
I(n)	RED	ON	Digital Input 'n' : ON State
		OFF	Digital Input 'n' : OFF State
Q(n)	RED	ON	Digital Output 'n' : ON State
		OFF	Digital Input 'n' : OFF State

MODBUS REGISTERS MAPPING


Register	Description	Access
40001	--Reserved--	R/W
40002	Firmware [0]	R
40003	Firmware [1]	R
40004	Name [0]	R/W
40005	Name [1]	R/W
40006	--Reserved--	R/W
40007	Node ID	R/W
40008	--Reserved--	R/W
40009	Digital Inputs	R/W
40010	Digital Outputs	R/W
40011	System Flags	R/W
40012	--Reserved--	-

40018		
40019	COM Settings	R/W
40020	--Reserved--	-

40026		
40027	Analogue In 0	R
40028	Analogue In 1	R
40029	--Reserved--	-

40032		
40033	Analogue Out 0	R/W
40034	Analogue Out 1	R/W

MECHANICAL DIMENSIONS (mm)

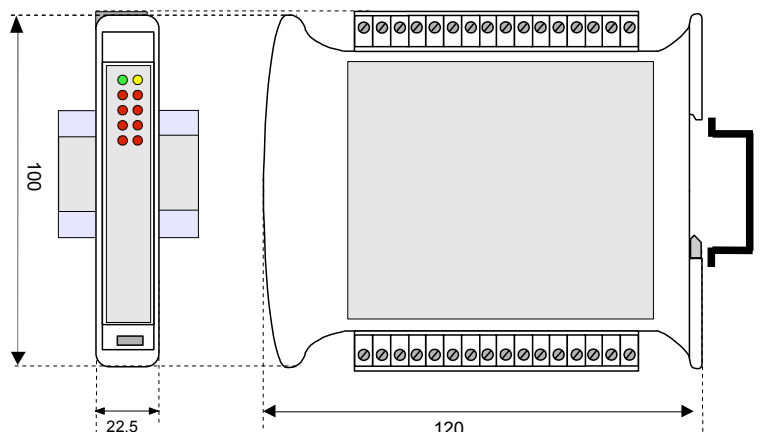

HOW TO ORDER

DAT3011 can be supplied with the configuration specified by the customer.

ORDER CODE:

DAT 3011 / Pt100 / 20 mA

Input type channel 1

Input type channel 2

■ = Requested
□ = Optional