

#### **GENERAL DESCRIPTION**

The device DAT 3140 is able to acquire up to 4 digital inputs and to drive up to 8 transistor outputs type NPN. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network.

The device guarantees high accuracy and stable measure versus time and temperature. To ensure the plant safety, two Watch-Dog timer alarms are provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The DAT 3140 is in compliance with the Directive 2004/108/EC on the electromagnetic compatibility.

The DAT 3140 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market. The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

#### COMMUNICATION PROTOCOLS

The DAT3140 is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

#### USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device). Connect power supply, serial bus, digital inputs and outputs as shown in the "Wiring" section.

The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

### TECHNICAL SPECIFICATIONS (Typical @ 25 °C and under nominal conditions)

DIGITAL INPUTS		DIGITAL OUTPUTS		ISOLATION	
Number of Channels Input voltage (bipolar) Input Impedance Sample time	4 OFF State : 0÷3 V ON State : 10÷30 V 4.7 KOhm 20 ms	Number of Channels Type	8 NPN	Inputs – Outputs Inputs – RS485 Inputs – Supply Outputs – RS485 Outputs – Supply RS-485 – Supply	1000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min.
		Max. Voltage Max. Load	30 Vdc 600 mA per channel 3A per module	ENVIRONMENTAL CONDITIONS	
		Over-current protection	NO	Operative Temperature UL Operative Temperature Storage Temperature	-40°C +85°C
		Data Transmission Baud Rate Max. distance	38.4 Kbps 1.2 Km – 4000 ft	Humidity (not condensed) Maximum Altitude Installation Category of installation Pollution Degree	0 90 % 2000 m Indoor II 2
		POWER SUPPLY Power supply voltage Reverse polarity protection Current consumption	10 30 Vdc 60 Vdc max 45 mA max.	MECHANICAL SPECIFIC Material IP Code Wiring Tightening Torque Mounting Weight	ATIONS Self-extinguish plastic IP20 wires with diameter 0.8+2.1 mm <sup>2</sup> /AWG 14-18 0.5 N m in compliance to DIN rail standard EN-50022 about 150 g.
				CERTIFICATIONS EMC ( for industrial envi Immunity Emission UL US Standard Canadian Standard CCN Typology Classification File Number	ronments) EN 61000-6-2 EN 61000-6-4 UL 61010-1 CSA C22.2 No 61010-1 NRAQ/NRAQ7 Open Type device Industrial Control Equipment E352854

# **INSTALLATION INSTRUCTIONS**

The DAT 3140 is suitable to be mounted on DIN rail, in vertical position. For a correct working and a long life of the device, read the following indications.


In case of the devices are mounted side by side, please leave about 5mm between in the following situations:

Temperature in the cabinet higher than 45 °C and high supply voltage (>27Vdc).

Avoid to place raceways or other objects which could obstruct the ventilation slits. It is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Avoid to install the devices in a site where vibrations are present.

It is recommended to use shielded cable for connecting signals. The shield must be connected to an earth wire provided for this purpose. Moreover it is suggested to avoid routing conductors near power signal cables.


# CABLING

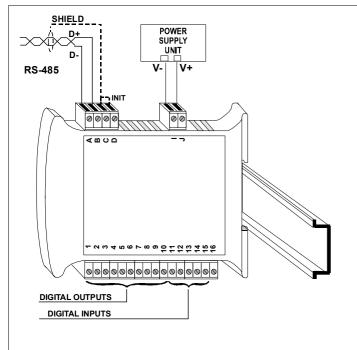

### LIGHT SIGNALLING


LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered or wrong RS-485 connection
		RAPID BLINK	Communication in progress (the blink frequency depends to the Baud-rate)
		SLOW BLINK	~1 sec Watch-Dog Alarm condition

### MECHANICAL DIMENSIONS (mm)

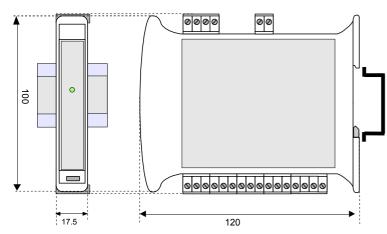


# WIRING


DIGITAL INPUTS

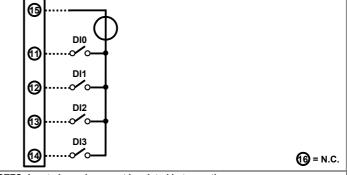


NOTES: Input channels are not insulated between them DIGITAL OUTPUTS

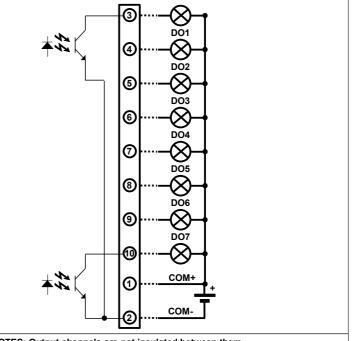


NOTES: Output channels are not insulated between them **RS-485 NETWORK** INIT





**POWER SUPPLY (\*)** 



(\*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

